

STORM FRONT™ WINDOWS

Specifications

SECTION 08 51 13 ALUMINUM WINDOWS

QUALITY ASSURANCE

Drawings and specifications are based on Series IW8000 Single Hung, IW8100 Fixed, or IW8200 Horizontal Sliding (*Specify*) CW60 Hurricane Resistant Thermal Windows as manufactured by U.S. Aluminum. Whenever substitute products are to be considered, supporting technical literature, samples, drawings, and performance data must be submitted 10 days prior to bid in order to make a valid comparison of the products involved. Test reports certified by an AAMA independent test laboratory must be made available upon request.

PART 1 GENERAL

1.01 Work Included

A. Furnish and install aluminum architectural windows complete with hardware and related components as shown on drawings and specified in this section.

(Specify glass and glazing in this section if window assemblies are to be glazed by the window manufacturer. If glazing is to be done by a different contractor, glass and glazing should be specified in Section 08 80 00).

B. 1-7/32" (31) Thick Glass and Glazing

1. All units shall be factory glazed.
OR
1. Reference Section 08 80 00 for Glass and Glazing.

List work and materials related to this section but specified in other sections.

1.02 Related Work

Section 08 40 00 - Entrances and Storefronts
Section 08 44 00 - Glazed Curtain Walls
Section 08 50 00 - Windows

Hurricane Resistant Single Hung, Sliding, and Fixed Windows

- Series IW8000
- Series IW8100
- Series IW8200

1.03 Testing and Performance Requirements

A. Test Units

1. Air, water, and structural test unit shall conform to requirements set forth in ANSI/AAMA/NWWDA 101 I.S. 2-97 and AAMA 910-93 or CSA A440.
2. Thermal test unit sizes shall be 47-1/4" x 59" (1200 x 1500) for Series IW8000 and IW8100, 59" x 47-1/4" (1500 x 1200) for Series IW8200. Unit shall consist of a single hung, fixed or horizontal sliding window.

B. Test Procedures and Performances

1. Windows shall conform to all AAMA/ANSI/NWWDA-101 I.S. 2-97 and AAMA 910-93 or CSA A440 requirements for the window type referenced in 1.01.B. In addition, the following specific performance requirements shall be met.

2. Air Infiltration Test -

With ventilators closed and locked, test unit in accordance with ASTM E 283-91 at a static air pressure difference of 6.24 psf. Air infiltration shall not exceed .30 cfm per foot of crack.

3. Water Resistance Test -

With ventilators closed and locked, test unit in accordance with ASTM E 331-96/ASTM E 547 at a static air pressure difference of 12 psf. There shall be no uncontrolled water leakage.

4. Uniform Load Deflection Test -

With ventilators closed and locked, test unit in accordance with ASTM E 330-97 at a static air pressure difference of 90 psf positive and negative pressure. No member shall deflect over L/175 of its span.

5. Condensation Resistance Test (CRF) -

With ventilators closed and locked, test unit in accordance with AAMA 1503. Condensation Resistance Factor (CRF) shall not be less than 49 for Series IW8100 and IW8200. Not less than 50 for Series IW8000.

6. Thermal Transmittance Test (Conductive U-Value) -

With ventilators closed and locked, test unit in accordance with NFRC 100 and AAMA 1503. Conductive thermal transmittance (U-Value) for Series IW8000 and IW8200 Windows shall have a range between 0.35 to 0.56 BTU/hr/ft²/°F and Series IW8100 Windows shall have a range between 0.33 to 0.56 BTU/hr/ft²/°F.

7. AAMA CW60 Rating

Testing Procedures -

- AAMA/WDMA/CSA 101/I.S.2/A440-0.8 - Laboratory Performance Testing.
- AAMA 503-08 - Newly Installed Fenestration Products.
- AAMA 511-08 - Installed Fenestration Products After 6 Months.

8. Hurricane Resistant Testing as per Miami/Dade County Protocols TAS 201, 202, and 203.

1.04 Quality Assurance

A. Provide test reports from AAMA accredited laboratories certifying the performance as specified in 1.05 or 11.15 of CSA A440.

B. Test reports shall be accompanied by the window manufacturer's letter of certification, stating the tested window meets or exceeds the referenced criteria for the appropriate AAMA/NWWDA 101/I.S.2-97 and AAMA 910-93 or CSA A440 window type.

1.05 Submittals

A. Contractor shall submit shop drawings, finish samples, test reports, and warranties.

STORM FRONT™ WINDOWS

Specifications

SECTION 08 51 13 ALUMINUM WINDOWS

1.06 Warranties

A. Total Window System

1. The responsible contractor shall assume full responsibility and warrant for one year the satisfactory performance of the total window installation which includes that of the windows, hardware, glass (including insulating units), glazing, anchorage and setting system, sealing, flashing, etc., as it relates to air, water, and structural adequacy as called for in the specifications and approved shop drawings.

PART 2 PRODUCTS

2.01 Materials

A. Aluminum

1. Extruded aluminum shall be 6063-T5 alloy and tempered.

B. Hardware

1. Series IW8000 and IW8200 Windows have spring loaded self-locking latches as supplied by U.S. Aluminum.

C. Weatherstrip

1. For Series IW8000 and IW8200 Windows weatherstrip shall be fin seal or equal. For Series IW8100 Windows all weatherstrip shall be E.P.D.M.

D. Thermal Barrier

1. Barrier material shall be poured in-place two part polyurethane. To ensure that composite strength remains unaltered during thermal cycling, a mechanical bond between the aluminum and the thermal filling shall be created by mechanically abrading the extrusion thermal cavity prior to filling with the polyurethane polymer. A non-structural thermal barrier is unacceptable.

2. Specified hardware shall not bridge the thermal barrier.

Hurricane Resistant Single Hung, Sliding, and Fixed Windows

- Series IW8000
- Series IW8100
- Series IW8200

PART 3 EXECUTION

3.01 Inspection

A. Job Conditions

1. Verify that openings are dimensionally within allowable tolerances, plumb, level, clean, provide a solid anchoring surface, and are in accordance with approved shop drawings.

3.02 Installation

A. Use only skilled tradesmen with work done in accordance with approved shop drawings and specifications.

B. Adequately anchor to maintain positions permanently when subjected to normal thermal movement, specified building movement, and specified wind loads.

C. Adjust windows for proper operation after installation.

D. Furnish and apply sealants to provide a weather tight installation at all joints and intersections and at opening perimeters.

3.03 Protection and Cleaning

A. After completion of window installation, windows shall be inspected, adjusted, put into working order and left clean, free of labels, dirt, etc. Protection from this point shall be the responsibility of the general contractor.



STORM FRONT™ WINDOWS

Special Features

FOR 1-7/32" (31) GLAZING

Hurricane Resistant
Single Hung Window
• Series IW8000



As part of the 8000 Series of heavy commercial windows, the IW8000 Hurricane Resistant Single Hung Window offers a 4-1/2" (114) deep frame designed to match typical building conditions, including our entrances and storefronts. An efficient, thermally insulated frame accepts 1-7/32" (31) glazing, with extruded pulls at the interlock and bottom rail. The window features a self-locking latch and Class 5 balances for ease of operation. Accessories such as Mulling Bars, Subsills, Head and Jamb Channels are available.

The high performance IW8000 Window is both AAMA CW60 Rated and NFRC Certified, and meets the stringent requirements of the Miami/Dade County Protocols TAS 201, 202, and 203 for maximum protection from high winds and wind-borne debris.

- AAMA CW60 Rated Window
- Accepts 1-7/32" (31) Glazing
- 4-1/2" (114) Deep Frame to Match Entrances and Storefronts
- Thermally Insulated-NFRC Certified

- Choice of Block or Fin Frame
- Class 5 Balance for Ease of Operation
- Available in an Array of Architectural Coatings and Anodized Finishes
- Made in the U.S.A.




Hurricane Resistant
Single Hung Window

Online usalum.com By Phone (800) 262-5151
Online crlaurence.com By Phone (800) 421-6144


STORM FRONT™ WINDOWS

Typical Details

FOR 1-7/32" (31) GLAZING

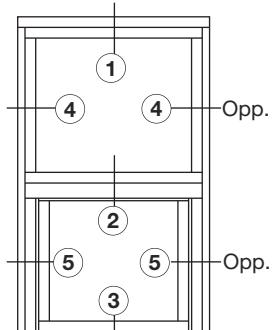

TYPICAL ELEVATION

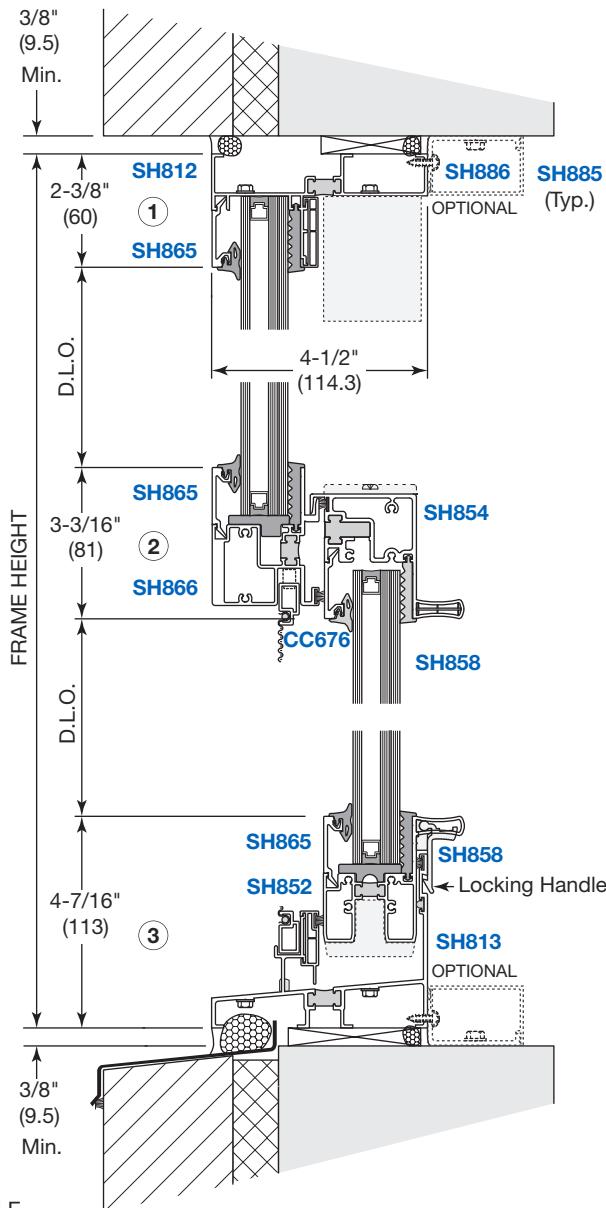

Block Frame
Installation Method Shown

Maximum Frame Size
65" x 91" (1651 x 2311)

A complete set of details
in DWG format is available
at usalum.com

Hurricane Resistant Single Hung Window

• Series IW8000

Meets or Exceeds Specifications:

- AAMA/WDMA/CSA 101/1.S.2/A 440-08
 - ASTM E 283-04
 - ASTM E 330-02
 - ASTM E 331-00
 - AAMA 1503
- NFRC
 - NFRC 100-2004
 - NFRC 200-2004
 - NFRC 500-2004
- MIAMI/DADE COUNTY PROTOCOLS
 - TAS 201
 - TAS 202
 - TAS 203

