



**NFRC 102-2014 THERMAL PERFORMANCE  
TEST REPORT**

**Rendered to:**

**CR LAURENCE CO., INC.**

**SERIES/MODEL: Impact Resistant Doors**

**TYPE: Swinging Door with Frame**

Summary of Results			
Standardized Thermal Transmittance (U-Factor)			0.76
Unit Size:	37-3/4" x 82-3/8" (959 mm x 2092 mm) (Model Size)		
Layer 1:	1/4"	Clear	
Gap:	0.75"	A1-D: Aluminum Spacer	100% Air*
Layer 2:	1/4"	PPG Solarban 60 (e=0.035*, #3)	

Reference must be made to Report No. G1019.01-301-46, dated 10/18/16 for complete test specimen description and data.



## **NFRC 102-2014 THERMAL PERFORMANCE TEST REPORT**

Rendered to:

CR LAURENCE CO., INC.  
2100 East 38th Street  
Vernon, California 90058

Report Number: G1019.01-301-46  
Test Date: 09/02/16  
Report Date: 10/18/16

### **Test Sample Identification:**

**Series/Model:** Impact Resistant Doors

**Type:** Swinging Door with Frame

**Overall Size:** 37-3/4" x 82-3/8" (959 mm x 2092 mm) (Model Size)

**NFRC Standard Size:** 37.8" x 82.3" (960 mm wide x 2090 mm high)

**Test Sample Submitted by:** Client

**Test Sample Submitted for:** Validation for Initial Certification (Production Line Unit) & Plant Qualification

**Test Procedure:** U-Factor tests were performed in a Guarded Hot Box in accordance with NFRC 102-2014, *Procedure for Measuring the Steady-State Thermal Transmittance of Fenestration Systems*.

### **Test Results Summary:**

Standardized U-factor ( $U_{st}$ ): 0.76 Btu/hr·ft<sup>2</sup>·F (CTS Method)

## Test Sample Description:

### Frame:

<b>Material:</b>	AL: Aluminum (Non-thermally broken)		
<b>Size:</b>	37-3/4" x 82-3/8" (Model Size)		
<b>Daylight Opening:</b>	N/A	<b>Glazing Method:</b>	N/A
<b>Exterior Color:</b>	Head/Jambs: Grey Sill: Mill Finish	<b>Exterior Finish:</b>	Head/Jambs: Anodized Sill: Mill Finish
<b>Interior Color:</b>	Head/Jambs: Grey Sill: Mill Finish	<b>Interior Finish:</b>	Head/Jambs: Anodized Sill: Mill Finish
<b>Corner Joinery:</b>	Coped / Screws / Sealed		

### Panel:

<b>Material:</b>	AL: Aluminum (Non-thermally broken)		
<b>Size:</b>	32-1/2" x 79-1/4"		
<b>Daylight Opening:</b>	22-3/4" x 66-7/8"	<b>Glazing Method:</b>	Interior
<b>Exterior Color:</b>	Grey	<b>Exterior Finish:</b>	Anodized
<b>Interior Color:</b>	Grey	<b>Interior Finish:</b>	Anodized
<b>Corner Joinery:</b>	Square Cut / Screws / Sealed		

### Glazing Information:

Layer 1:	1/4"	Clear	
Gap:	0.75"	A1-D: Aluminum Spacer	100% Air*
Layer 2:	1/4"	PPG Solarban 60 (e=0.035*, #3)	
Gas Fill Method:	N/A*		

*\*Stated per Client/Manufacturer*

*N/A Non-Applicable*

**Test Sample Description: (Continued)**

**Weatherstripping:**

Description	Quantity	Location
Hollow vinyl bulb gasket	1 Row	All frame members.

**Hardware:**

Description	Quantity	Location
Hinge	3	Hinge jamb/stile.
Handle with lock assembly	1	Lock stile.
Keeper	1	Lock jamb.

**Drainage:**

Drainage Method	Size	Quantity	Location
No visible weeps.			

## Thermal Transmittance (U-factor)

### Measured Test Data

#### Heat Flows

1. Total Measured Input into Metering Box ( $Q_{total}$ )	1411.96 Btu/hr
2. Surround Panel Heat Flow ( $Q_{sp}$ )	75.19 Btu/hr
3. Surround Panel Thickness	5.00 inches
4. Surround Panel Conductance	0.0358 Btu/hr·ft <sup>2</sup> ·F
5. Metering Box Wall Heat Flow ( $Q_{mb}$ )	-2.02 Btu/hr
6. EMF vs Heat Flow Equation (equivalent information)	0.0119*EMF + 0.000
7. Flanking Loss Heat Flow ( $Q_{fl}$ )	18.55 Btu/hr
8. Net Specimen Heat Loss ( $Q_s$ )	1320.23 Btu/hr

#### Areas

1. Test Specimen Projected Area ( $A_s$ )	21.59 ft <sup>2</sup>
2. Test Specimen Interior Total (3-D) Surface Area ( $A_h$ )	26.69 ft <sup>2</sup>
3. Test Specimen Exterior Total (3-D) Surface Area ( $A_c$ )	21.59 ft <sup>2</sup>
4. Metering Box Opening Area ( $A_{mb}$ )	53.48 ft <sup>2</sup>
5. Metering Box Baffle Area ( $A_{bi}$ )	52.23 ft <sup>2</sup>
6. Surround Panel Interior Exposed Area ( $A_{sp}$ )	31.89 ft <sup>2</sup>

#### Test Conditions

1. Average Metering Room Air Temperature ( $t_h$ )	69.80 F
2. Average Cold Side Air Temperature ( $t_c$ )	-0.44 F
3. Average Guard/Environmental Air Temperature	72.00 F
4. Metering Room Average Relative Humidity	13.60 %
5. Metering Room Maximum Relative Humidity	14.05 %
6. Metering Room Minimum Relative Humidity	13.26 %
7. Measured Cold Side Wind Velocity (Perpendicular Flow)	12.66 mph
8. Measured Warm Side Wind Velocity (Parallel Flow)	0.04 mph
9. Measured Static Pressure Difference Across Test Specimen	0.00" ± 0.04"H <sub>2</sub> O

#### Average Surface Temperatures

1. Metering Room Surround Panel	66.59 F
2. Cold Side Surround Panel	0.68 F

#### Results

1. Thermal Transmittance of Test Specimen ( $U_s$ )	0.87 Btu/hr·ft <sup>2</sup> ·F
2. Standardized Thermal Transmittance of Test Specimen ( $U_{st}$ )	0.76 Btu/hr·ft <sup>2</sup> ·F

## Thermal Transmittance (U-factor)

### Calculated Test Data

#### CTS Method

1. Warm Side Emittance of Glass ( $e_i$ )	0.84
2. Cold Side Emittance of Glass	0.84
3. Warm Side Frame Emittance*	0.80
4. Cold Side Frame Emittance*	0.80
5. Warm Side Sash/Panel/Vent Emittance*	0.80
6. Cold Side Sash/Panel/Vent Emittance*	0.80
7. Warm Side Baffle Emittance ( $e_{b1}$ )	0.92
8. Cold Side Baffle Emittance ( $e_{b2}$ )	N/A
9. Equivalent Warm Side Surface Temperature	30.49 F
10. Equivalent Cold Side Surface Temperature	10.99 F
11. Warm Side Baffle Surface Temperature	68.76 F
12. Cold Side Baffle Surface Temperature	N/A F
13. Measured Warm Side Surface Conductance ( $h_h$ )	1.56 Btu/hr·ft <sup>2</sup> ·F
14. Measured Cold Side Surface Conductance ( $h_c$ )	5.35 Btu/hr·ft <sup>2</sup> ·F
15. Test Specimen Thermal Conductance ( $C_s$ )	3.14 Btu/hr·ft <sup>2</sup> ·F
16. Convection Coefficient ( $K_c$ )	0.35 Btu/(hr·ft <sup>2</sup> ·F <sup>1.25</sup> )
17. Radiative Test Specimen Heat Flow ( $Q_{rl}$ )	586.14 Btu/hr
18. Conductive Test Specimen Heat Flow ( $Q_{cl}$ )	734.09 Btu/hr
19. Radiative Heat Flux of Test Specimen ( $q_{rl}$ )	27.14 Btu/hr·ft <sup>2</sup> ·F
20. Convective Heat Flux of Test Specimen ( $q_{cl}$ )	33.99 Btu/hr·ft <sup>2</sup> ·F
21. Standardized Warm Side Surface Conductance ( $h_{sth}$ )	1.23 Btu/hr·ft <sup>2</sup> ·F
22. Standardized Cold Side Surface Conductance ( $h_{stc}$ )	5.28 Btu/hr·ft <sup>2</sup> ·F
23. Standardized Thermal Transmittance ( $U_{st}$ )	0.76 Btu/hr·ft <sup>2</sup> ·F

#### Test Duration

1. The environmental systems were started at 10:54 hours, 09/01/16.
2. The test parameters were considered stable for two consecutive four hour test periods from 22:46 hours, 09/01/16 to 06:46 hours, 09/02/16.
3. The thermal performance test results were derived from 02:46 hours, 09/02/16 to 06:46 hours, 09/02/16.

The reported Standardized Thermal Transmittance ( $U_{st}$ ) was determined using CTS Method, per Section 9.2(A) of NFRC 102.

*\*Stated per NFRC 101*

## Glazing Deflection:

	Glazing
Edge Gap Width	0.75"
Estimated center gap width upon receipt of specimen in laboratory (after stabilization)	0.73"
Center gap width at laboratory ambient conditions on day of testing	0.73"
Center gap width at test conditions	0.65"

*Glass collapse determined using a digital glass and air space meter*

The sample was inspected for the formation of frost or condensation, which may influence the surface temperature measurements. The sample showed no evidence of condensation/frost at the conclusion of the test.

“This test method does not include procedures to determine the heat flow due to either air movement through the specimen or solar radiation effects. As a consequence, the thermal transmittance results obtained do not reflect performances which are expected from field installations due to not accounting for solar radiation, air leakage effects, and the thermal bridge effects that have the potential to occur due to the specific design and construction of the fenestration system opening. The latter can only be determined by in-situ measurements. Therefore, it is important to recognize that the thermal transmittance results obtained from this test method are for ideal laboratory conditions and should only be used for fenestration product comparisons and as input to thermal performance analyses which also include solar, air leakage and thermal bridge effects.”

The test sample was installed in a vertical orientation, the exterior of the specimen was exposed to the cold side. The direction of heat transfer was from the interior (warm side) to the exterior (cold side) of the specimen. The ratings were rounded in accordance to NFRC 601, NFRC Unit and Measurement Policy. The data acquisition frequency is 5 minutes.

ANSI/NCSL Z540-2-1997 type B uncertainty for this test was 1.62%.

Required annual calibrations for the Architectural Testing Inc., an Intertek company ("Intertek-ATI"), 'thermal test chamber' (ICN 004287) in Fresno, California were last conducted in April 2016 in accordance with Intertek-ATI calibration procedure. A CTS Calibration verification was performed February 2016. A Metering Box Wall Transducer and Surround Panel Flanking Loss Characterization was performed April 2016.

"Ratings included in this report are for submittal to an NFRC licensed IA for certification purposes and are not meant to be used for labeling purposes. Only those values identified on a valid Certification Authorization Report (CAR) are to be used for labeling purposes."

Intertek-ATI will service this report for the entire test record retention period. Test records that are retained such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation will be retained by Intertek-ATI for the entire test record retention period. The test record retention end date for this report is September 02, 2020.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen tested. This report may not be reproduced, except in full, without the written approval of Intertek-ATI.

For INTERTEK-ATI

Tested By:



Digitally Signed by: William Smeds

William Simon Smeds  
Technician

Reviewed By:



Digitally Signed by: Kenny C. White

Kenny C. White  
Laboratory Manager  
Individual-In-Responsible-Charge

WSS:ss

G1019.01-301-46

Attachments (pages): This report is complete only when all attachments listed are included.

- Appendix-A: CTS Calibration Data (1)
- Appendix-B: Surround Panel Wiring Diagram (1)
- Appendix-C: Baffle Wiring Diagram (1)
- Appendix-D: Submittal Form and Drawings (15)



### Revision Log


<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
0	10/18/16	All	Original Report Issue. Work requested by Mr. Ronald Wooten of CR Laurence Co., Inc.


This report produced from controlled document template ATI 00025(a), revised 04/21/2016.

**Appendix A: CTS Calibration Data**

1. CTS Test Date	07/28/15
2. CTS Size	38.75 ft <sup>2</sup>
3. CTS Glass/Core Conductance	0.40 Btu/hr·ft <sup>2</sup> ·F
4. Warm Side Air Temperature	69.79 F
5. Cold Side Air Temperature	-0.29 F
6. Warm Side Average Surface Temperature	54.96 F
7. Cold Side Average Surface Temperature	3.56 F
8. Convection Coefficient (K <sub>c</sub> )	0.35 Btu/(hr·ft <sup>2</sup> ·F <sup>1.25</sup> )
9. Measured Cold Side Surface Conductance (h <sub>c</sub> )	5.35 Btu/hr·ft <sup>2</sup> ·F
10. Measured Thermal Transmittance	0.31 Btu/hr·ft <sup>2</sup> ·F

## Appendix B: Surround Panel Wiring Diagram

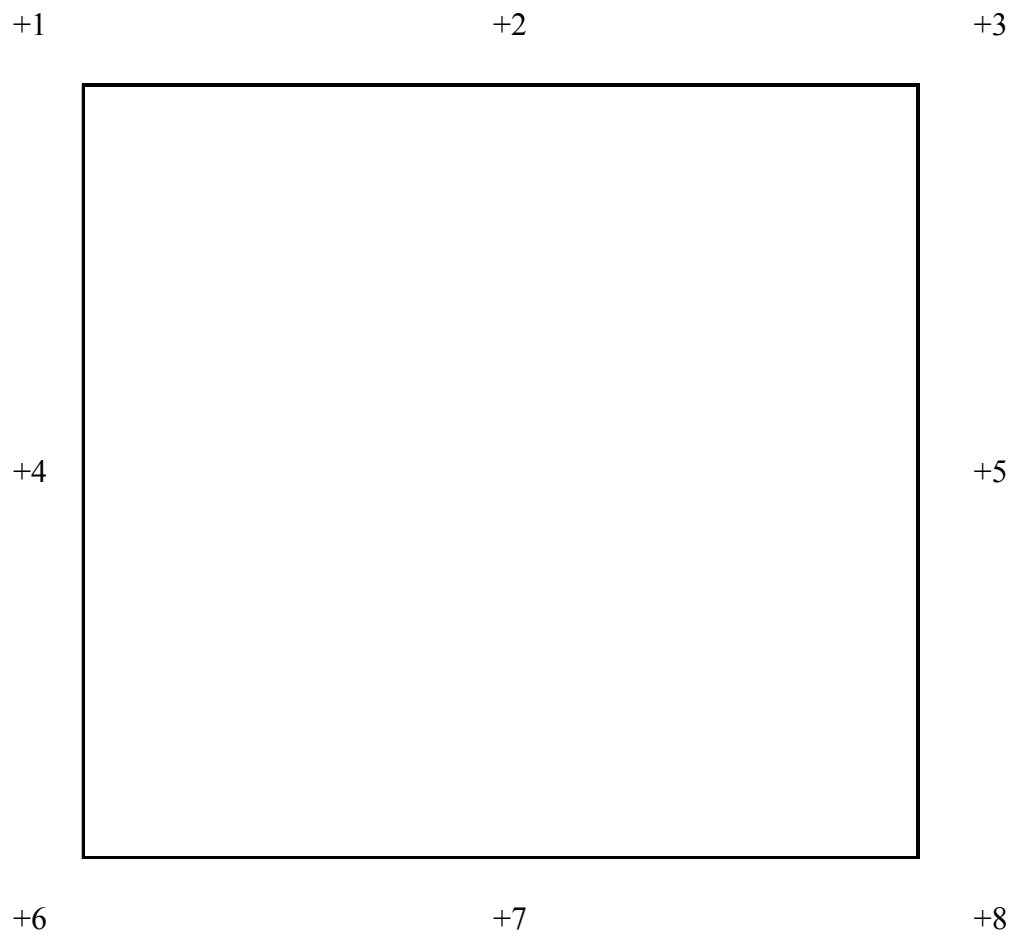

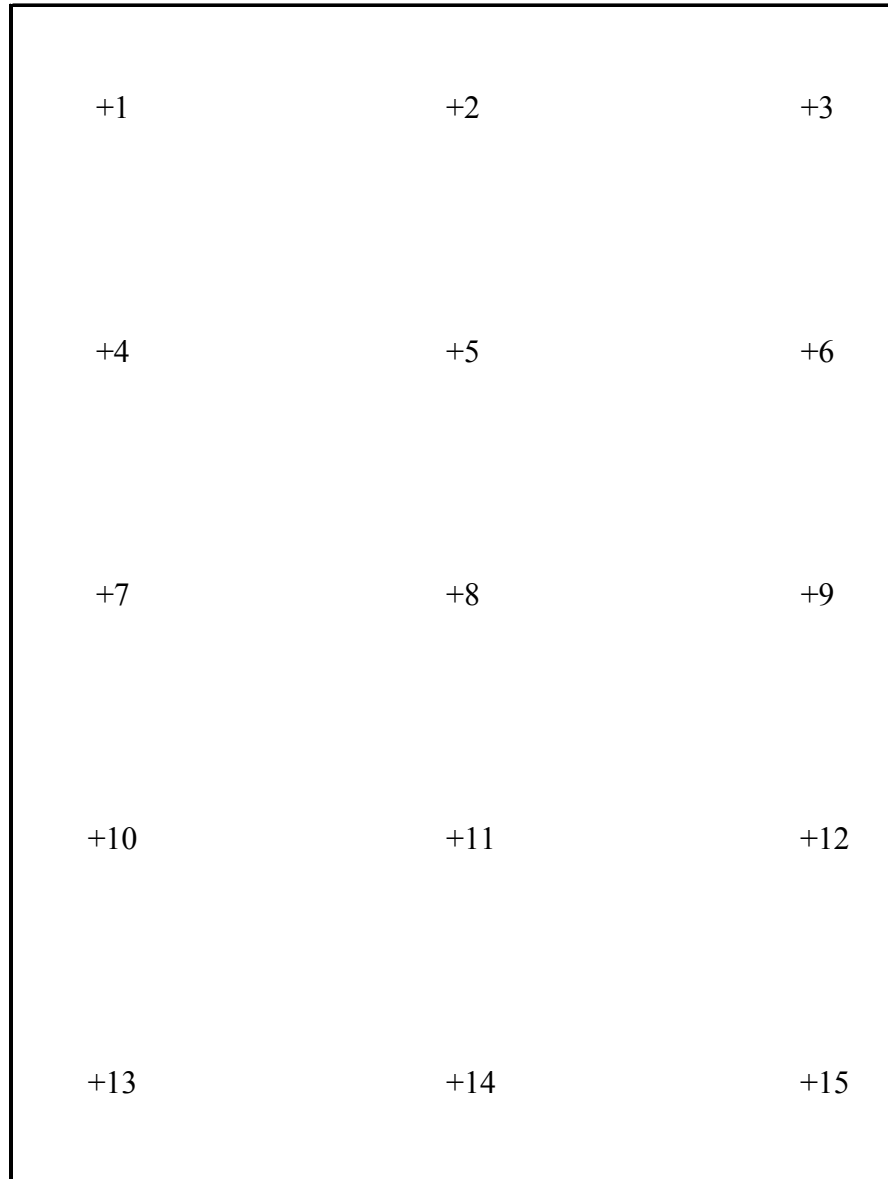
**Appendix C: Baffle Wiring Diagram**

## **Appendix D: Submittal Form and Drawings**

# NFRC PRODUCT CERTIFICATION PROGRAM

## Submittal Form for Test Samples

For use by Manufacturers, Lineal Suppliers and Fabricators



National Fenestration  
Rating Council®

1. Information on Production of the Test Sample (complete ALL fields):

Manufacturer: C.R. Laurence Co., Inc. Date of sample manufacture: 6/25/2016  
Plant Address where manufactured: 2100 E. 38th Street.  
City: Vernon State: CA Zip Code: 90058  
Name of IA: Associated Laboratories Inc. Phone: (214) 565 - 1094 Fax: \_\_\_\_\_

2. Product Information (complete APPLICABLE fields):

Existing Product Line ID (CPD) No.: IG600 Product/Operator Type  
(Table 4-3 of NFRC 100): Door  
Series/Model: Impact Resistant Doors

3. Test sample is being submitted for (select ONE):

- a. ☐ Validation for Initial Certification (prototype only) no plant qualification
- b. ☒ Validation for Initial Certification or Recertification (production line unit) & plant qualification
- c. ☐ Plant Qualification Only (production line unit)
- d. ☐ Test Only Alternative (production line unit) & plant qualification

I, Chien Huang, as the designated agent for C.R. Laurence Co., Inc.  
do hereby attest that the foregoing information is true to the best of my information, knowledge, and belief.  
Further, if the unit is identified in Section 3 as a production line unit, I hereby authorize the NFRC-accredited  
testing laboratory to send a copy of the test report to the IA identified above for plant qualification purposes  
pursuant to the NFRC Product Certification Program.

Signature: [Signature] Date: 7/26/2016


### For Laboratory Use Only

1. Laboratory: INTERTEK  
2. Date Sample Received: 7/5/16 Test Report #: G1019.01-301-46  
3. Date Sample Tested: 9/2/16 By: Simon Smalls  
4. Modifications made: NONE

**Company Name: CR Laurence**

Series/Model: IG600 Hurricane Resistant Entrance Door


[illegible]

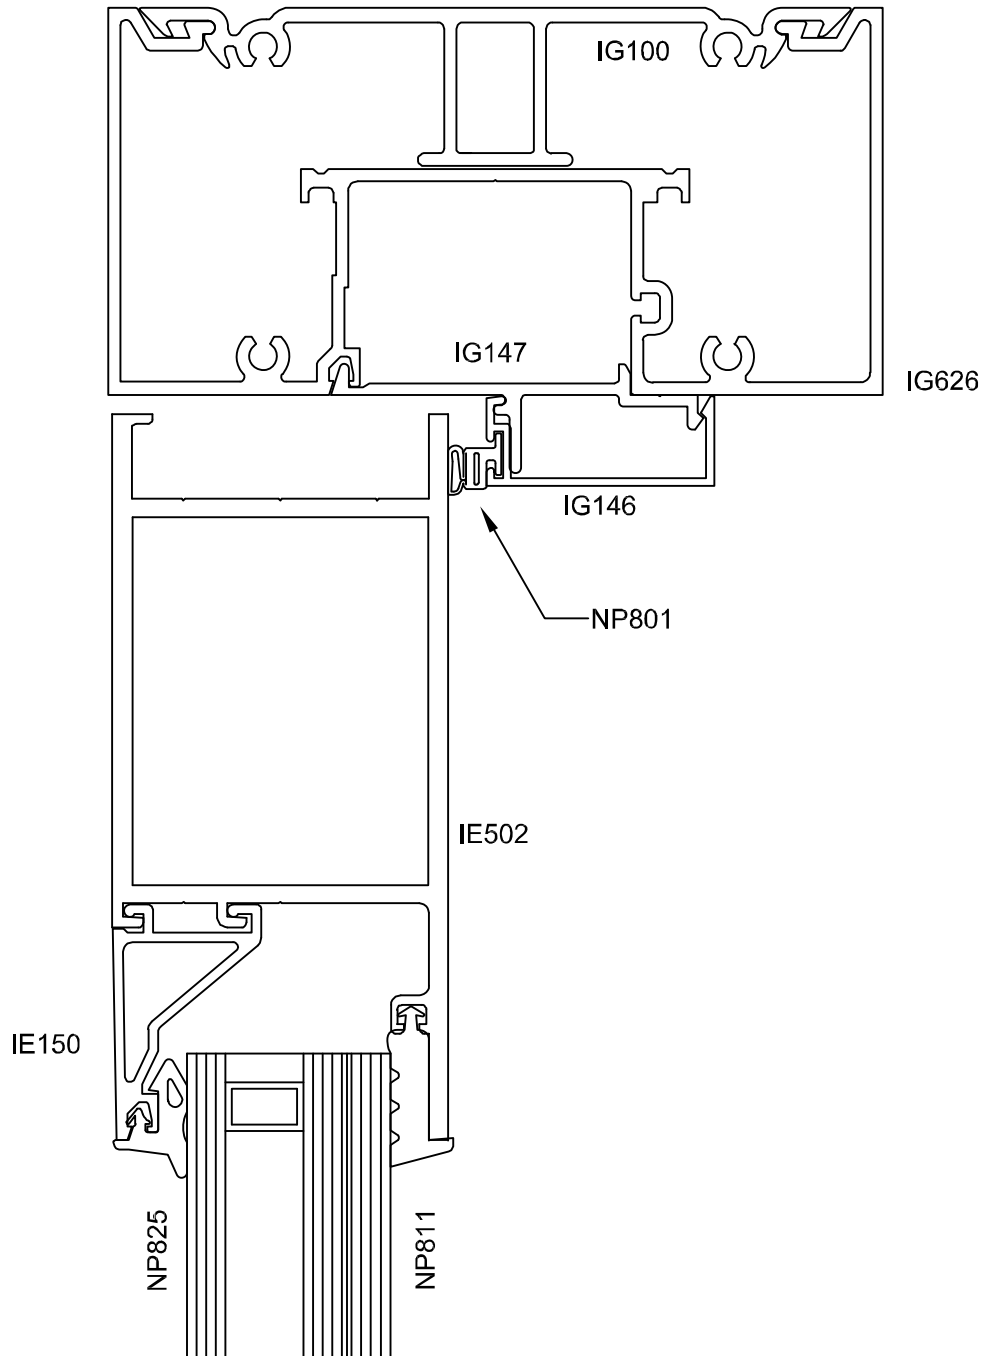


# IG600 HURRICANE RESISTANT ENTRANCE TOP RAIL

IG626 / IG100 / IG147 / IG146 / IE502 / IE150



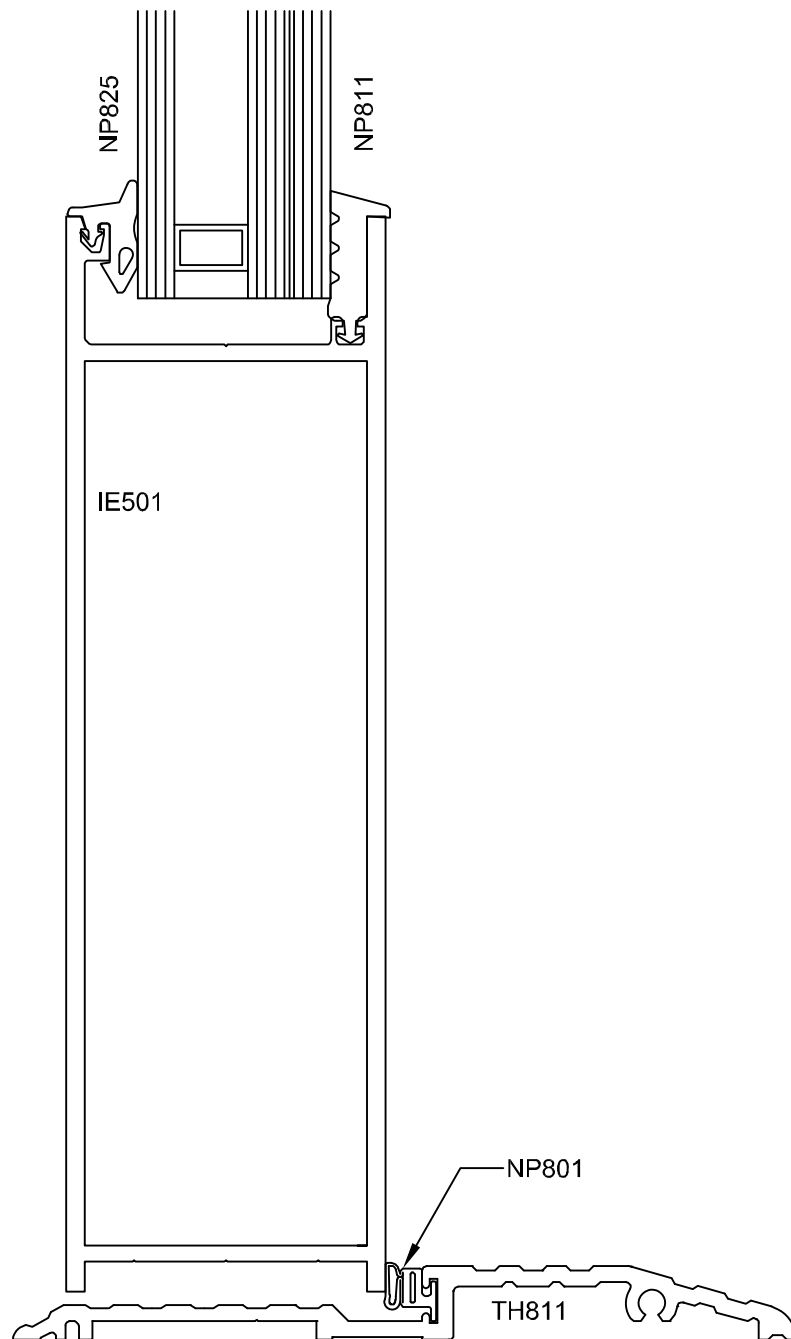

**IG600 HURRICANE RESISTANT  
ENTRANCE 7" BOTTOM RAIL  
AIR RESISTANT THRESHOLD  
IE501 / TH811**

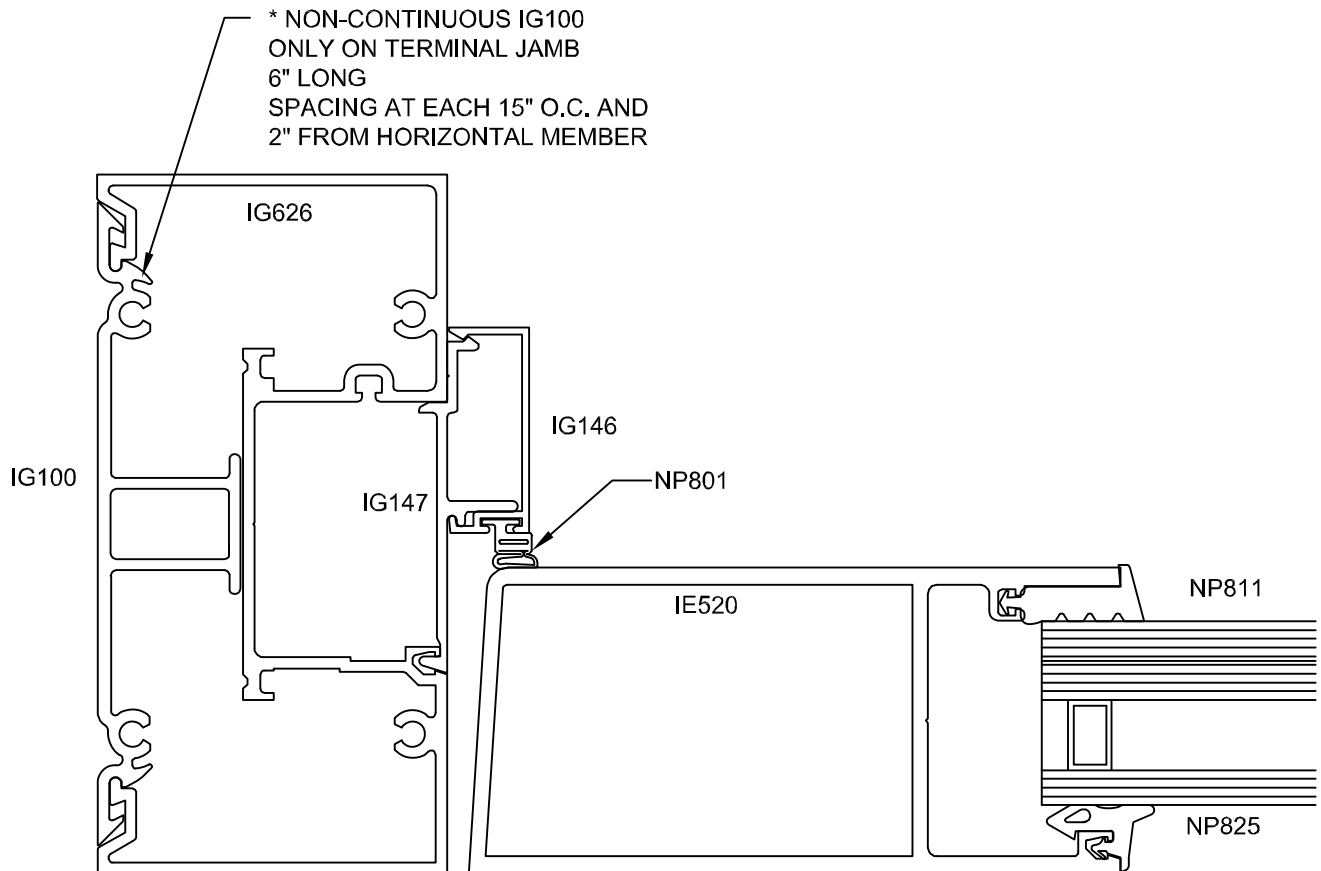

## IG600 HURRICANE RESISTANT ENTRANCE JAMB

IG626 / IG100 / IG147 / IG146 / IE520